


MBA MOTOR DRIVEN FIRE ALARM BELL

24VDC
INDOOR / OUTDOOR
WALL MOUNT ONLY

MBA6_040521_Henry_a

MBA-6-24
MBA-8-24
MBA-10-24

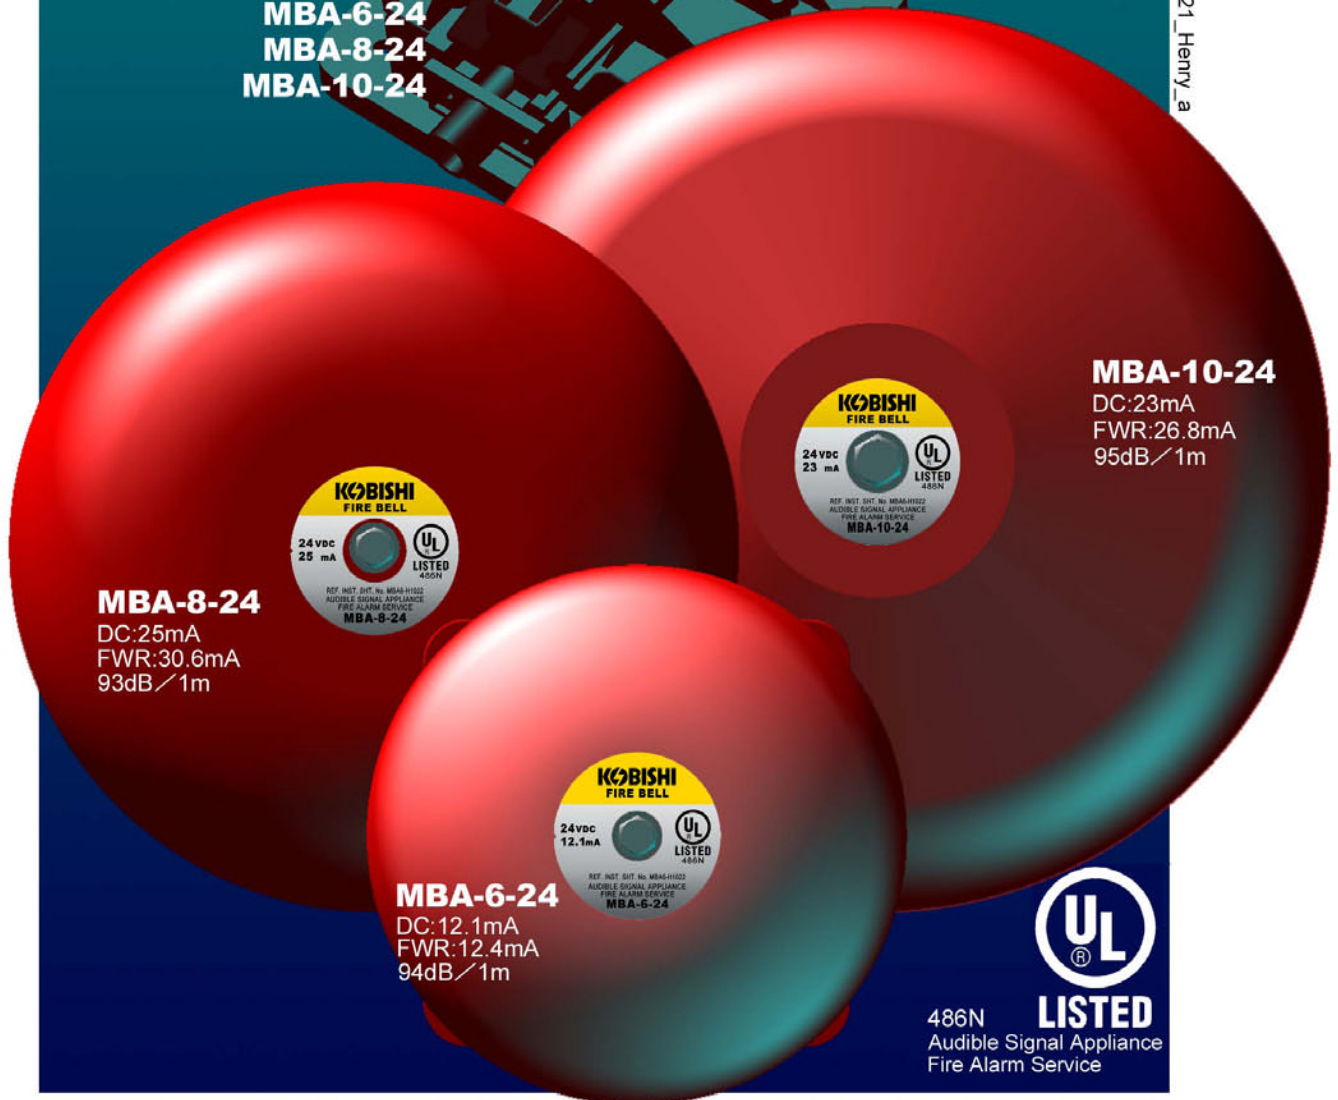

MBA-8-24
DC:25mA
FWR:30.6mA
93dB/1m

MBA-6-24
DC:12.1mA
FWR:12.4mA
94dB/1m


MBA-10-24
DC:23mA
FWR:26.8mA
95dB/1m

UL LISTED
486N
Audible Signal Appliance
Fire Alarm Service

DESIGN AND SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE

- ▲CAN BE USED AT OUTDOOR
- ▲VERY LOW CURRENT CONSUMPTION ONLY 12.1mA at 24VDC
(Model MBA-6-24)



Installation

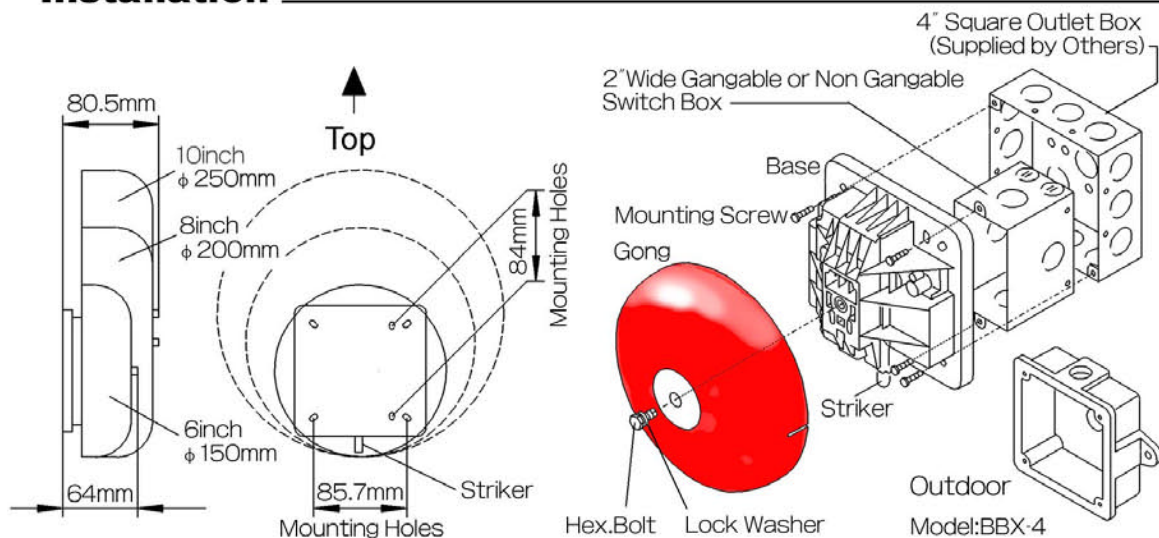

Wiring

From proceeding signal or F.A.C.P.

To next bell or End-of-line resistor (E.O.L.R)

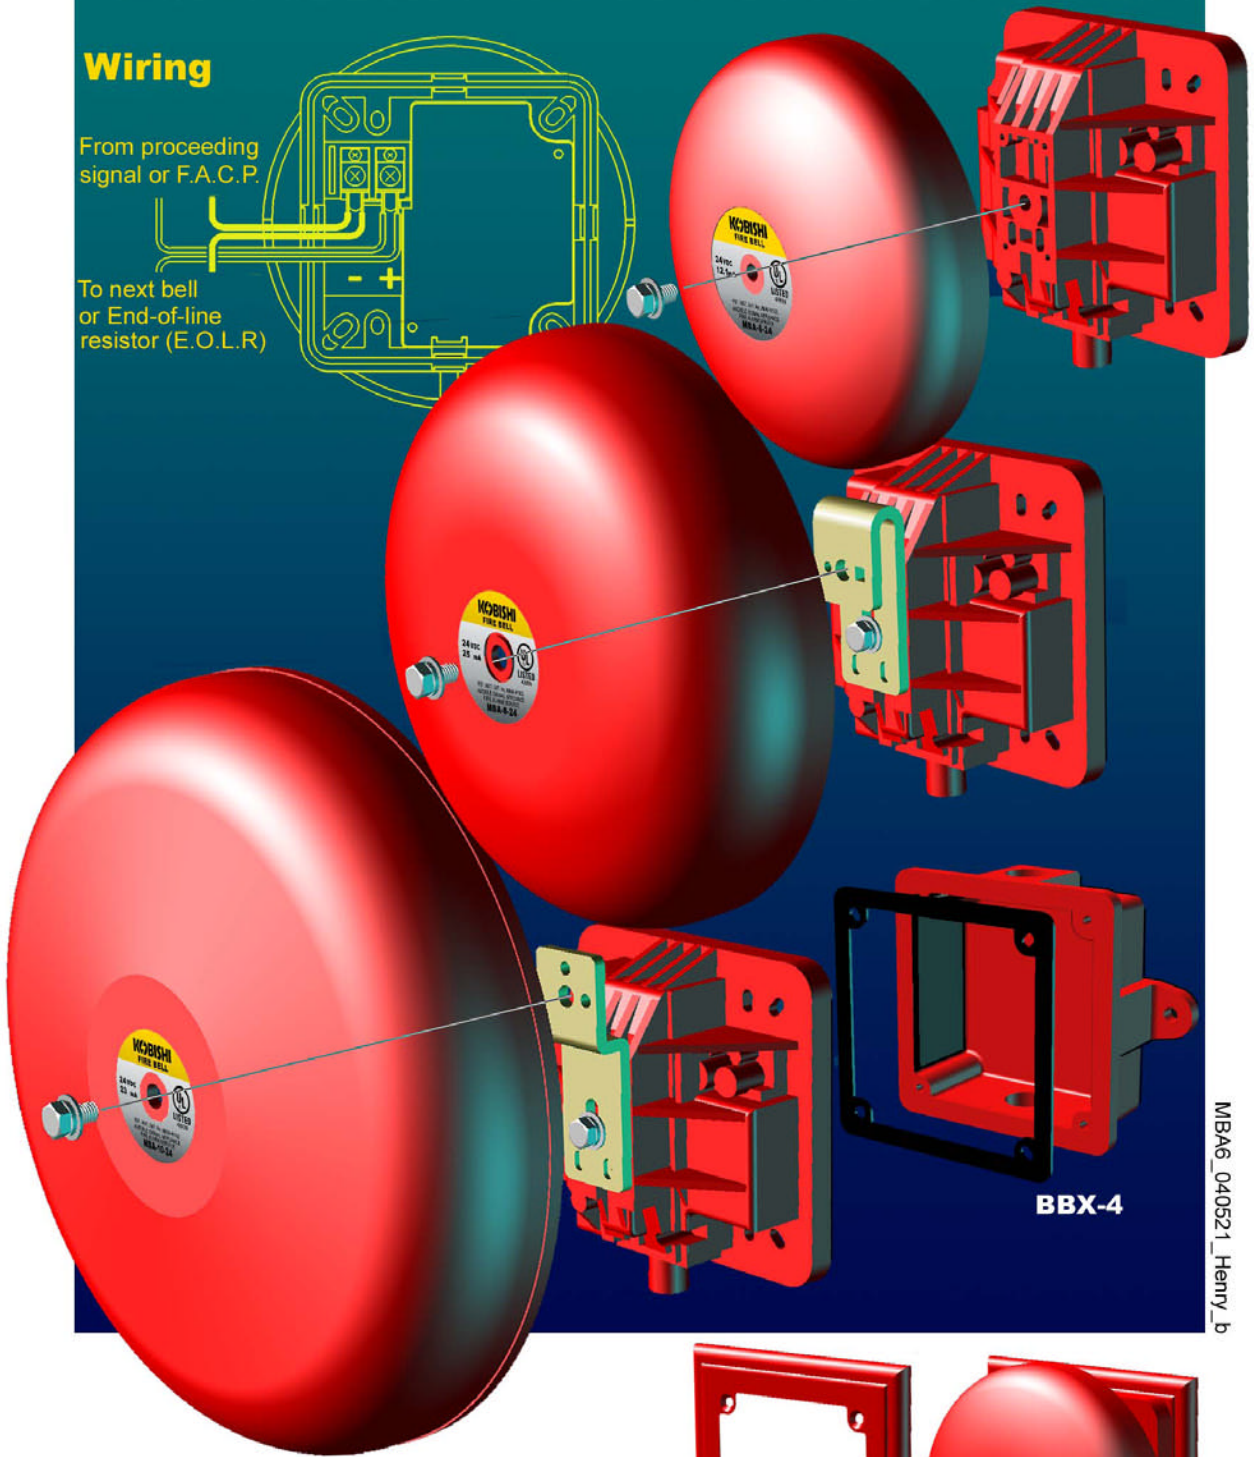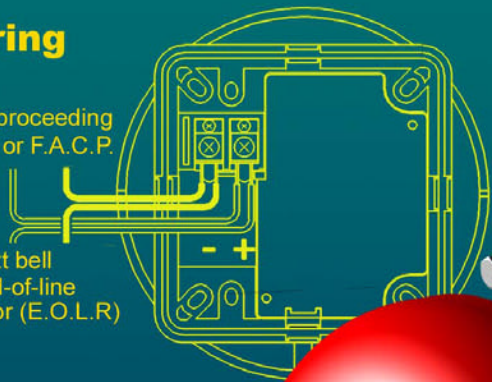


MBA6_040521_Henry_b



RETROFIT PLATE

The retrofit plate SP-115 or RSB series strobe allows to operate bell/strobe combination in the field. The plate available in red or white color.

RSB series

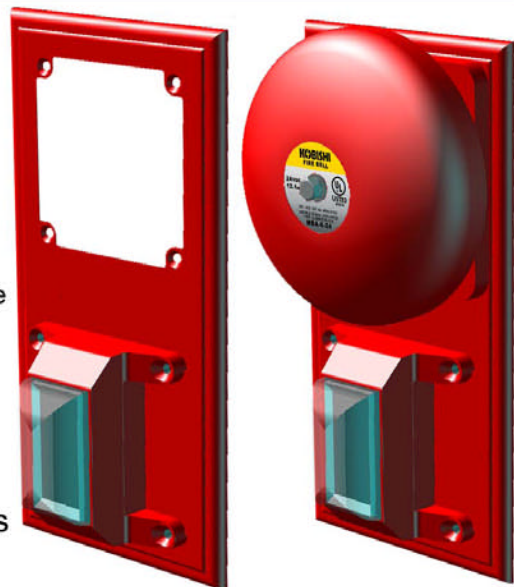

KOBISHI ELECTRIC CO.,LTD.
OVERSEAS DEPT.



1805-1 KAMIYA, KOUNOSU-SHI, SAITAMA-KEN, 365-0027 JAPAN
PHONE : 81-485-43-4767 FAX : 81-485-43-4776

SP-115